

MP27BUS

Communicative globe valve actuator for 2-way and 3-way globe valves

- Actuating force 1000 N
- Nominal voltage AC/DC 24 V
- Control modulating, communicative 2...10 V variable
- Stroke 20 mm
- Communication via Belimo MP-Bus
- Conversion of sensor signals



Technical data

| Electrical data | Nominal voltage | AC/DC 24 V |
|------------------------|------------------------------------|--|
| | Nominal voltage frequency | 50/60 Hz |
| | Nominal voltage range | AC 19.228.8 V / DC 21.628.8 V |
| | Power consumption in operation | 3.5 W |
| | Power consumption in rest position | 1.5 W |
| | Power consumption for wire sizing | 5.5 VA |
| | Connection supply / control | Terminals 4 mm ² (cable ø410 mm) |
| | Parallel operation | Yes (note the performance data) |
| | | |
| Data bus communication | Communicative control | MP-Bus |
| | Number of nodes | MP-Bus max. 8 |
| Functional data | Actuating force motor | 1000 N |
| | Operating range Y | 210 V |
| | Input impedance | 100 kΩ |
| | Operating range Y variable | Start point 0.530 V |
| | | End point 2.532 V |
| | Operating modes optional | Open/close |
| | | 3-point (AC only) |
| | Position feedback U | Modulating (DC 032 V) 210 V |
| | Position feedback U note | Max. 0.5 mA |
| | Position feedback U variable | Start point 0.58 V |
| | rosition reedback o variable | End point 2.510 V |
| | Position accuracy | ±5% |
| | Manual override | with push-button, can be locked |
| | Stroke | 20 mm |
| | Running time motor | 35 s / 20 mm |
| | Running time motor variable | 3590 s |
| | Adaptation setting range | manual (automatic on first power-up) |
| | Adaptation setting range variable | No action |
| | | Adaptation when switched on |
| | | Adaptation after pushing the manual override |
| | | button |
| | Override control | MAX (maximum position) = 100% |
| | | MIN (minimum position) = 0% ZS (intermediate position, AC only) = 50% |
| | Override control variable | MAX = (MIN + 33%)100% |
| | | ZS = MINMAX |
| | | |



Technical data sheet

| Functional data | Sound power level, motor | 60 dB(A) |
|-----------------|--|---|
| | Position indication | Mechanical, 520 mm stroke |
| Safety data | Protection class IEC/EN | III, Safety Extra-Low Voltage (SELV) |
| | Power source UL | Class 2 Supply |
| | Degree of protection IEC/EN | IP54 |
| | Degree of protection NEMA/UL | NEMA 2 |
| | Enclosure | UL Enclosure Type 2 |
| | EMC | CE according to 2014/30/EU |
| | Certification IEC/EN | IEC/EN 60730-1 and IEC/EN 60730-2-14 |
| | UL Approval | cULus according to UL60730-1A, UL60730-2-14 and CAN/CSA E60730-1 |
| | | The UL marking on the actuator depends on the production site, the device is UL-compliant in any case |
| | Type of action | Type 1 |
| | Rated impulse voltage supply / control | 0.8 kV |
| | Pollution degree | 3 |
| | Ambient humidity | Max. 95% RH, non-condensing |
| | Ambient temperature | 050°C [32122°F] |
| | Storage temperature | -4080°C [-40176°F] |
| | Servicing | maintenance-free |
| Weight | Weight | 1.8 kg |

Safety notes



- This device has been designed for use in stationary heating, ventilation and air-conditioning systems and must not be used outside the specified field of application, especially in aircraft or in any other airborne means of transport.
- Outdoor application: only possible in case that no (sea) water, snow, ice, insolation or aggressive gases interfere directly with the device and that it is ensured that the ambient conditions remain within the thresholds according to the data sheet at any time.
- Only authorised specialists may carry out installation. All applicable legal or institutional installation regulations must be complied with during installation.
- The switch for changing the direction of motion and so the closing point may be adjusted only by authorised specialists. The direction of motion is critical, particularly in connection with frost protection circuits.
- The device may only be opened at the manufacturer's site. It does not contain any parts that can be replaced or repaired by the user.
- The device contains electrical and electronic components and must not be disposed of as household refuse. All locally valid regulations and requirements must be observed.

Product features

Operating mode Conventional operation:

The actuator is connected with a standard control signal of 0...10 V and drives to the position defined by the control signal. The measuring voltage U serves for the electrical display of the actuator position 0.5...100% and as control signal for other actuators.

Operation on Bus:

The actuator receives its digital control signal from the higher level controller via the MP-Bus and drives to the position defined. Connection U serves as communication interface and does not supply an analogue measuring voltage.

Technical data sheet

| BELIMO |
|------------------|
| Product features |

| Converter for sensorsConnection option for a sensor (passive or active sensor or switching contact). The MP actuator serves as an analogue/digital converter for the transmission of the sensor signal via MP-Bus to the higher level system.Parametrisable actuatorsThe factory settings cover the most common applications. Single parameters can be modified with the Belimo service tools MFI-P or ZTH EU.Mounting on third-party valvesThe factory settings cover the most common applications. Single parameters can be modified with the Belimo service tools MFI-P or ZTH EU.Mounting on third-party valvesThe factory settings cover the most common applications. Single parameters are comprised of an actuator, bracket, and valve setmo begin with, then attach the factorIT+ bracket to the valve neck adapter. Now fit the RetroFIT+ actuators for the target of the installed valve permits.Mounting on Belimo valvesUse standard actuators from Belimo for mounting on Belimo globe valves. The installation of RetroFIT+ actuator in the bracket and universal valve permits.Mounting on Belimo valvesWanual override with push-button possible (the gear train is disengaged for as long as the button is pressed or remains locked).Manual overrideManual override with push-button possible (the gear train is disengaged for as long as the button is pressed or remains locked).High functional reliabilityThe actuator stem is retracted.High functional reliabilityThe factory setting: Actuator stem is retracted.Adaptation and synchronisationAn adaptation, which is when the operating range and position feedback adjust themselves to the mechanical setting range.Adaptation and synchronisationAn adaptation and briggered manually by pressing the "Adaptation" button or with the C | | |
|---|--------------------------------|---|
| with the Belimo service tools MFT-P or ZTH EU. Mounting on third-party valves The RetroFIT+ actuators for installation on a wide range of valves from various manufacturers are comprised of an actuator, bracket, universal valve neck adapter and universal valve stem adapter. Adapt the valve neck adapter and universal valve stem adapter. Adapt the valve neck adapter and universal valve stem to begin with, then attach the RetroFIT+ bracket to the valve neck. Adapter and the conduct the commissioning process. The valve neck adapter/actuator can be totated by 360° on the valve closing point into account, secure the actuator to the bracket and then conduct the commissioning process. The valve neck adapter/actuator can be rotated by 360° on the valve neck, provided the size of the installed valve permits. Mounting on Belimo valves Use standard actuators from Belimo for mounting on Belimo globe valves. The installation of RetroFIT+ actuators on Belimo globe valves is technically possible. Manual override Manual override with push-button possible (the gear train is disengaged for as long as the button is pressed or remains locked). The stroke can be adjusted by using a hexagon socket screw key (4 mm), which is inserted into the top of the actuator. The stroke shaft extends when the key is rotated clockwise. High functional reliability The actuator is overload protected, requires no limit switches and automatically stops when the end stop is reached. Home position Factory setting: Actuator stem is retracted. The first time the supply voltage is switched on, i.e. at the time of commissioning, the actuator carries out an adaptation, which is inserted during the adaptation (netime setting range). Automatic synchronisation can be triggered manually by pre | Converter for sensors | actuator serves as an analogue/digital converter for the transmission of the sensor signal via |
| are comprised of an actuator, bracket, universal valve neck adapter and universal valve stem adapter. Adapt the valve neck adapter. Now fit the RetroFIT+ actuator into the bracket and connect it to the valve neck adapter. Now fit the RetroFIT+ actuator into the bracket and connect it to the valve. Whilst taking the position of the valve closing point into account, secure the actuator to the bracket and then conduct the commissioning porcess. The valve neck adapter/actuator can be rotated by 360° on the valve neck, provided the size of the installed valve permits.Mounting on Belimo valvesUse standard actuators from Belimo for mounting on Belimo globe valves. The installation of RetroFIT+ actuators on Belimo globe valves is technically possible.Manual overrideManual override with push-button possible (the gear train is disengaged for as long as the button is pressed or remains locked). The stroke can be adjusted by using a hexagon socket screw key (4 mm), which is inserted into the top of the actuator. The stroke shaft extends when the key is rotated clockwise.High functional reliabilityThe actuator is overload protected, requires no limit switches and automatically stops when the end stop is reached.Actuator screw is to the mechanical setting range. The first time the supply voltage is switched on, i.e. at the time of commissioning, the actuator carries out an adaptation, which is when the operating range and position feedback adjust themselves to the mechanical setting range. The actuator them moves into the position defined by the control signal.Adaptation and synchronisation Soth mechanical net position is in the home position (0%). The actuator the moves into the position (0%). The actuator the moves into the position defined by the control signal. Arange of settings can be adapted using the PC-Tool (see MF | Parametrisable actuators | |
| RetroFIT+ actuators on Belimo globe valves is technically possible.Manual overrideManual override with push-button possible (the gear train is disengaged for as long as the button is pressed or remains locked). The stroke can be adjusted by using a hexagon socket screw key (4 mm), which is inserted into the top of the actuator. The stroke shaft extends when the key is rotated clockwise.High functional reliabilityThe actuator is overload protected, requires no limit switches and automatically stops when the end stop is reached.Home positionFactory setting: Actuator stem is retracted. The first time the supply voltage is switched on, i.e. at the time of commissioning, the actuator carries out an adaptation, which is when the operating range and position feedback adjust themselves to the mechanical setting range. The actuator then moves into the position defined by the control signal.Adaptation and synchronisationAn adaptation can be triggered manually by pressing the "Adaptation" button or with the PC- Tool. Both mechanical end stops are detected during the adaptation (entire setting range). Automatic synchronisation after pressing the manual override button is configured. The synchronisation is in the home position (0%). The actuator then moves into the position defined by the control signal. A range of settings can be adapted using the PC-Tool (see MFT-P documentation)Setting direction of motionWhen actuated, the stroke direction switch changes the running direction in normal operation. | Mounting on third-party valves | are comprised of an actuator, bracket, universal valve neck adapter and universal valve stem adapter. Adapt the valve neck and valve stem to begin with, then attach the RetroFIT+ bracket to the valve neck adapter. Now fit the RetroFIT+ actuator into the bracket and connect it to the valve. Whilst taking the position of the valve closing point into account, secure the actuator to the bracket and then conduct the commissioning process. The valve neck adapter/actuator |
| button is pressed or remains locked). The stroke can be adjusted by using a hexagon socket screw key (4 mm), which is inserted into the top of the actuator. The stroke shaft extends when the key is rotated clockwise. High functional reliability The actuator is overload protected, requires no limit switches and automatically stops when the end stop is reached. Home position Factory setting: Actuator stem is retracted. The first time the supply voltage is switched on, i.e. at the time of commissioning, the actuator carries out an adaptation, which is when the operating range and position feedback adjust themselves to the mechanical setting range. The actuator then moves into the position defined by the control signal. Adaptation and synchronisation An adaptation can be triggered manually by pressing the "Adaptation" button or with the PC-Tool. Both mechanical end stops are detected during the adaptation (entire setting range). Automatic synchronisation after pressing the manual override button is configured. The synchronisation is in the home position (0%). The actuator then moves into the position defined by the control signal. A range of settings can be adapted using the PC-Tool (see MFT-P documentation) When actuated, the stroke direction switch changes the running direction in normal operation. | Mounting on Belimo valves | ÷ ÷ |
| into the top of the actuator. The stroke shaft extends when the key is rotated clockwise.High functional reliabilityThe actuator is overload protected, requires no limit switches and automatically stops when the end stop is reached.Home positionFactory setting: Actuator stem is retracted. The first time the supply voltage is switched on, i.e. at the time of commissioning, the actuator carries out an adaptation, which is when the operating range and position feedback adjust themselves to the mechanical setting range. The actuator then moves into the position defined by the control signal.Adaptation and synchronisationAn adaptation can be triggered manually by pressing the "Adaptation" button or with the PC- Tool. Both mechanical end stops are detected during the adaptation (entire setting range). Automatic synchronisation after pressing the manual override button is configured. The synchronisation is in the home position (0%). The actuator then moves into the position defined by the control signal. A range of settings can be adapted using the PC-Tool (see MFT-P documentation)Setting direction of motionWhen actuated, the stroke direction switch changes the running direction in normal operation. | Manual override | |
| the end stop is reached.Home positionFactory setting: Actuator stem is retracted. The first time the supply voltage is switched on, i.e. at the time of commissioning, the actuator carries out an adaptation, which is when the operating range and position feedback adjust themselves to the mechanical setting range. The actuator then moves into the position defined by the control signal.Adaptation and synchronisationAn adaptation can be triggered manually by pressing the "Adaptation" button or with the PC- Tool. Both mechanical end stops are detected during the adaptation (entire setting range). Automatic synchronisation after pressing the manual override button is configured. The synchronisation is in the home position defined by the control signal. A range of settings can be adapted using the PC-Tool (see MFT-P documentation)Setting direction of motionWhen actuated, the stroke direction switch changes the running direction in normal operation. | | |
| The first time the supply voltage is switched on, i.e. at the time of commissioning, the actuator carries out an adaptation, which is when the operating range and position feedback adjust themselves to the mechanical setting range. The actuator then moves into the position defined by the control signal.Adaptation and synchronisationAn adaptation can be triggered manually by pressing the "Adaptation" button or with the PC- Tool. Both mechanical end stops are detected during the adaptation (entire setting range). Automatic synchronisation after pressing the manual override button is configured. The synchronisation is in the home position (0%). The actuator then moves into the position defined by the control signal. A range of settings can be adapted using the PC-Tool (see MFT-P documentation)Setting direction of motionWhen actuated, the stroke direction switch changes the running direction in normal operation. | High functional reliability | |
| The first time the supply voltage is switched on, i.e. at the time of commissioning, the actuator carries out an adaptation, which is when the operating range and position feedback adjust themselves to the mechanical setting range. The actuator then moves into the position defined by the control signal.Adaptation and synchronisationAn adaptation can be triggered manually by pressing the "Adaptation" button or with the PC- Tool. Both mechanical end stops are detected during the adaptation (entire setting range). Automatic synchronisation after pressing the manual override button is configured. The synchronisation is in the home position (0%). The actuator then moves into the position defined by the control signal. A range of settings can be adapted using the PC-Tool (see MFT-P documentation)Setting direction of motionWhen actuated, the stroke direction switch changes the running direction in normal operation. | Home position | Factory setting: Actuator stem is retracted. |
| Adaptation and synchronisationAn adaptation can be triggered manually by pressing the "Adaptation" button or with the PC- Tool. Both mechanical end stops are detected during the adaptation (entire setting range). Automatic synchronisation after pressing the manual override button is configured. The synchronisation is in the home position (0%). The actuator then moves into the position defined by the control signal. A range of settings can be adapted using the PC-Tool (see MFT-P documentation)Setting direction of motionWhen actuated, the stroke direction switch changes the running direction in normal operation. | | The first time the supply voltage is switched on, i.e. at the time of commissioning, the actuator carries out an adaptation, which is when the operating range and position feedback adjust |
| Tool. Both mechanical end stops are detected during the adaptation (entire setting range).Automatic synchronisation after pressing the manual override button is configured. The synchronisation is in the home position (0%).The actuator then moves into the position defined by the control signal. A range of settings can be adapted using the PC-Tool (see MFT-P documentation)Setting direction of motionWhen actuated, the stroke direction switch changes the running direction in normal operation. | | The actuator then moves into the position defined by the control signal. |
| synchronisation is in the home position (0%). The actuator then moves into the position defined by the control signal. A range of settings can be adapted using the PC-Tool (see MFT-P documentation) Setting direction of motion When actuated, the stroke direction switch changes the running direction in normal operation. | Adaptation and synchronisation | |
| A range of settings can be adapted using the PC-Tool (see MFT-P documentation) Setting direction of motion When actuated, the stroke direction switch changes the running direction in normal operation. | | |
| Setting direction of motion When actuated, the stroke direction switch changes the running direction in normal operation. | | |
| operation. | | A range of settings can be adapted using the PC-Tool (see MFT-P documentation) |
| essories | Setting direction of motion | |
| | essories | |

Accessories

| Gateways | Description | Туре |
|------------------------|---|------------|
| | Gateway MP to BACnet MS/TP | UK24BAC |
| | Gateway MP to Modbus RTU | UK24MOD |
| Electrical accessories | Description | Туре |
| | Auxiliary switch 2x SPDT add-on | S2A-H |
| | MP-Bus power supply for MP actuators | ZN230-24MP |
| Mechanical accessories | Description | Туре |
| | Spacer ring for LDM, stroke 20 mm | ZNV-203 |
| | Spacer ring for Sauter, stroke 20 mm | ZNV-204 |
| | Adapter kit Danfoss | ZNV-205 |
| Tools | Description | Туре |
| | Service tool, with ZIP-USB function, for parametrisable and communicative Belimo actuators, VAV controller and HVAC performance devices | ZTH EU |



| Description | Туре | |
|--|---------|--|
| Belimo PC-Tool, Software for adjustments and diagnostics | MFT-P | |
| Adapter for Service-Tool ZTH | MFT-C | |
| Connecting cable 5 m, A: RJ11 6/4 ZTH EU, B: 6-pin for connection to | ZK1-GEN | |
| service socket | | |
| Connecting cable 5 m, A: RJ11 6/4 ZTH EU, B: free wire end for | ZK2-GEN | |
| connection to MP/PP terminal | | |

Electrical installation




Supply from isolating transformer.

Parallel connection of other actuators possible. Observe the performance data.

Direction of stroke switch factory setting: Actuator stem retracted (\blacktriangle).


Wiring diagrams

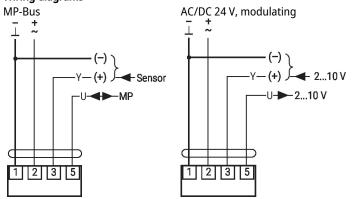


Functions

Functions with basic values (conventional mode)


Override control with AC 24 V with relay contacts

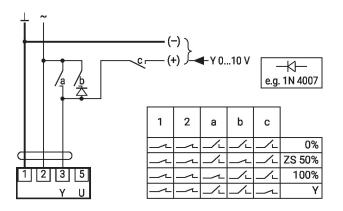

Override control with AC 24 V with Control remotely 0...100% with rotary switch




positioner SG..








Functions with basic values (conventional mode)

Minimum limit with positioner SG..
















Procedure

1. Connect 24 V to connections 1 and 2 2. Disconnect connection 3: - with direction of rotation L: Actuator rotates to the left - with direction of rotation R: Actuator rotates to the right 3. Short-circuit connections 2 and 3: - Actuator runs in opposite direction



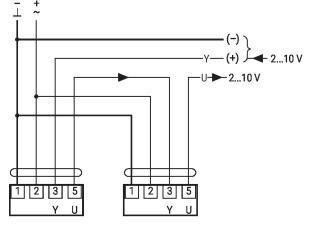

Caution:

The operating range must be set to DC 2...10 V. The 500 Ohm resistor converts the 4...20 mA current signal to a voltage signal DC 2...10 V.



Technical data sheet

Max. 8 additional MP-Bus nodes

Max. 8 additional MP-Bus


• Supply AC/DC 24 V

Resolution 30 mV

nodes

0...32 V)

Functions with specific parameters (Parametrisation necessary)



MP-Bus Network topology

There are no restrictions for the network topology (star, ring, tree or mixed forms are permitted).

Supply and communication in one and the same 3-wire cable


• no shielding or twisting

necessary • no terminating resistors

required


Connection of external switching contact

Connection of active sensors +~ ī MP 2 3 5 v

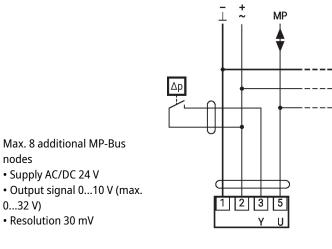

Max. 8 additional MP-Bus nodes • Switching current 16 mA @ 24 ٧

• Start point of the operating range must be parametrised on the MP actuator as ≥0.5 V



| Ni1000 | −28+98°C | 8501600 Ω ²⁾ |
|--------|-------------------------|--------------------------|
| PT1000 | −35+155°C | 8501600 Ω ²⁾ |
| NTC | −10+160°C ¹⁾ | 200 Ω60 kΩ ²⁾ |


1) Depending on the type 2) Resolution 1 Ohm Compensation of the measured value is recommended




Functions

Functions with specific parameters (Parametrisation necessary)

Override control and limiting with AC 24 V with relay contacts

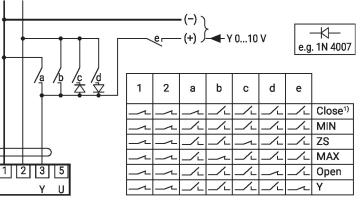


Override control and limiting with AC 24 V with rotary switch




Caution:

The "Close" function is only guaranteed if the start point of the operating range is defined as min. 0.5 V.



Control open/close



Control 3-point with AC 24 V



Operating controls and indicators


| | Direction of strok | e switch |
|-------------------------|--|--|
| | Switch over: | Direction of stroke changes |
| 2 | Push-button and | LED display green |
| | Off: | No power supply or malfunction |
| | On: | In operation |
| | Press button: | Triggers stroke adaptation, followed by standard mode |
| C [®] 3 | Push-button and | LED display yellow |
| | Off: | Standard mode |
| | On: | Adaptation or synchronisation process active |
| | Flickering: | MP-Bus communication active |
| | Flashing: | Request for addressing from MP client |
| Adaption → (2) | Press button: | Confirmation of the addressing |
| Address → C3 Status | Manual override l | button |
| 4 | Press button: | Gear train disengages, motor stops, manual override possible |
| | Release button: | Gear train engages, standard mode |
| 6 5 | Service plug For connecting pa | arametrisation and service tools |
| | Manual override | |
| | Clockwise: | Actuator stem extends |
| 7 | Counterclockwis | e: Actuator stem retracts |
| | | |

Service

Tool connection

Ection The actuator can be parametrised by ZTH EU via the service socket. For an extended parametrisation the PC tool can be connected.


Connection ZTH EU / PC-Tool

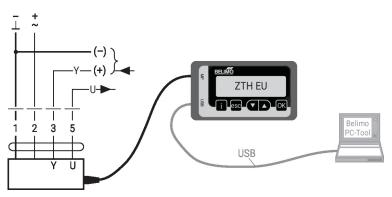





Dimensions

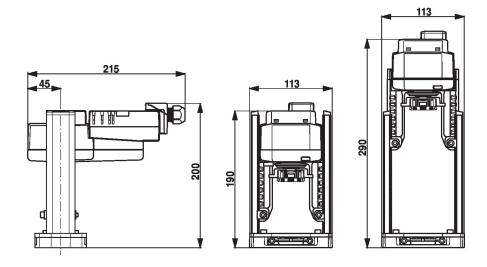

Further documentation

- Tool connections
- Introduction to MP-Bus Technology
- Overview MP Cooperation Partners
- Data sheets for globe valves
- Installation instructions for actuators